
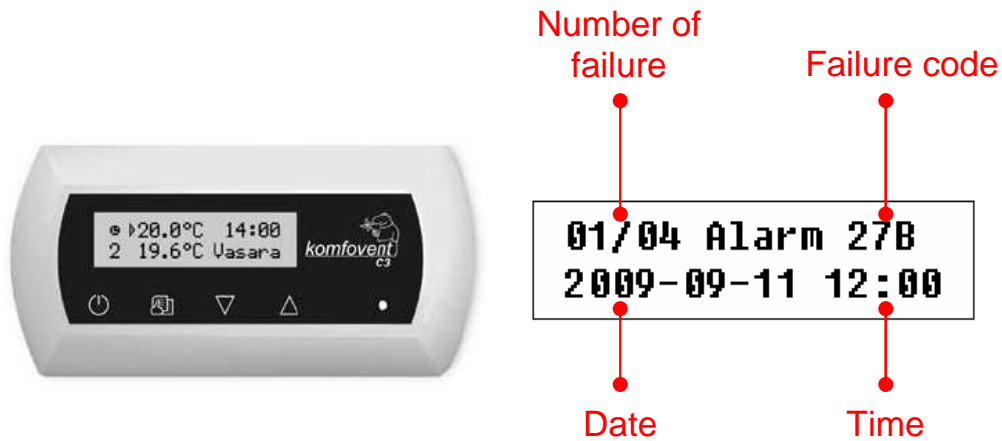


### C3 Onetouch FAILURE LOG

The new generation C3 control panel with touch sensitive buttons has a new function called FAILURE LOG. There is possibility to log over 20 failures combined with failure time and date.

To enter the LOG – hold  for 8 sec.



Failure code	Failure
01B	Supply fan breakdown
02B	Exhaust fan breakdown
03B	Rotary wheel breakdown on winter season
04B	Electrical heater overheating
06B	Fire alarm
09B	Supply air temperature probe breakdown
10B	Exhaust air temperature probe breakdown
11B	Outside air temperature probe breakdown
12B	Plate heat exchanger temperature probe breakdown
19B	Too low supply air temperature (<5°C)
20B	Too high supply air temperature (>45°C)
27B	Too low return water in heating coil (<9°C)
28B	Frost possibility in plate heat exchanger
11A	Rotary wheel failure on summer season
13A	Electric heater is off because of too low air flow
15A	Supply air filter is clogged
16A	Exhaust air filter is clogged

**Note:** **Class A** (11A) failure, unit will continue operating.  
**Class B** (01B) failure, unit will be stopped due to emergency.